

Water Softener Salt Requirements for Genoa Township Wastewater Systems

Wastewater: Genoa-Oceola Municipal Sewer
 Water: Private well
 Sodium based salt ALLOWED.

Wastewater: Lake Edgewood Municipal Sewer
 Water: Private well or City of Brighton Municipal Water
 Sodium based salt ALLOWED as of Jan 1, 2025.


Wastewater: Oak Pointe Municipal Sewer
 Water: Private well or Oak Pointe Municipal Water
 Sodium based salt ALLOWED.

Wastewater: Genoa-Oceola Municipal Sewer
 Water: MHOG Municipal Water
 You do not need a water softener. MHOG water is softened at the municipal water treatment plant.

Wastewater: Lake Edgewood Municipal Sewer
 Water: MHOG Municipal Water
 You do not need a water softener. MHOG water is softened at the municipal water treatment plant.

Note: Boundaries are approximate, please see Township Staff for parcel specific information

0 0.3 0.6 1.2 Miles

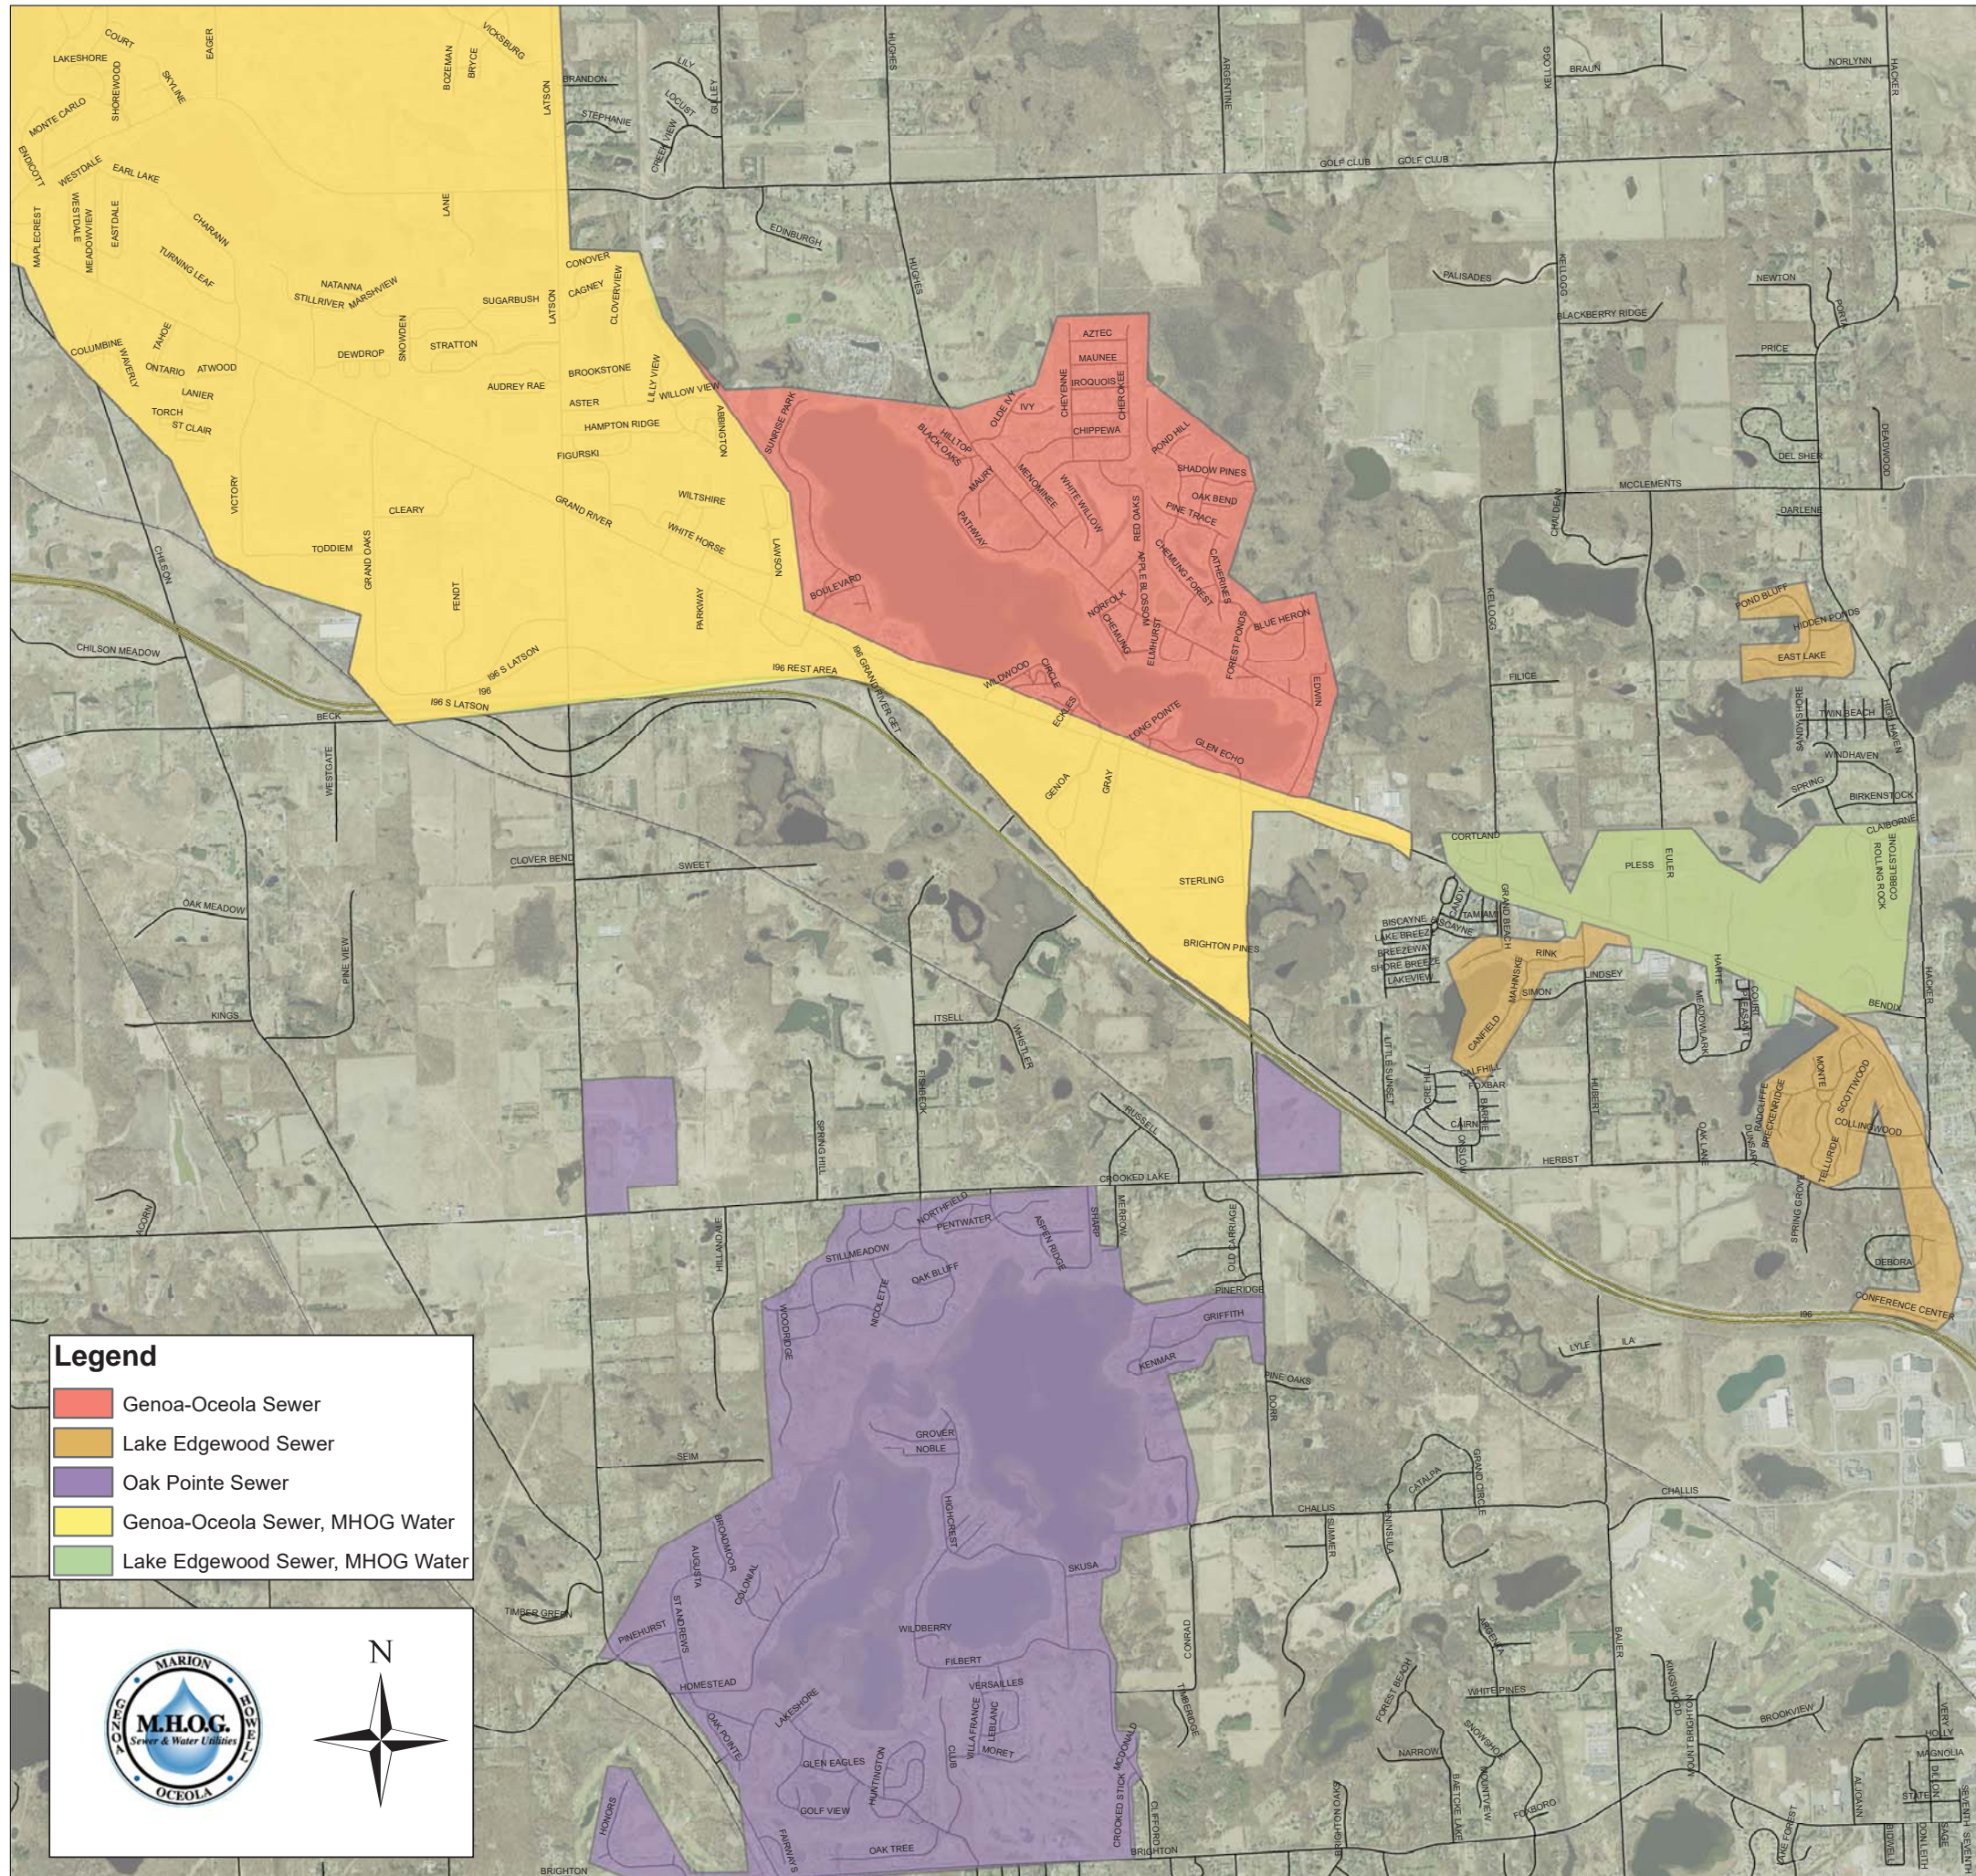

- Legend**
- Genoa-Oceola Sewer
 - Lake Edgewood Sewer
 - Oak Pointe Sewer
 - Genoa-Oceola Sewer, MHOG Water
 - Lake Edgewood Sewer, MHOG Water

