

Water Softener Salt Requirements for Genoa Township Wastewater Systems


Wastewater: Genoa-Oceola Municipal Sewer
 Water: Private well
 Sodium based salt ALLOWED.

Wastewater: Lake Edgewood Municipal Sewer
 Water: Private well or City of Brighton Municipal Water
 Potassium chloride salt is REQUIRED.

Wastewater: Oak Pointe Municipal Sewer
 Water: Private well or Oak Pointe Municipal Water
 Sodium based salt ALLOWED.

Wastewater: Genoa-Oceola Municipal Sewer
 Water: MHOG Municipal Water
 You do not need a water softener. MHOG water is softened at the municipal water treatment plant.

Wastewater: Lake Edgewood Municipal Sewer
 Water: MHOG Municipal Water
 You do not need a water softener. MHOG water is softened at the municipal water treatment plant.

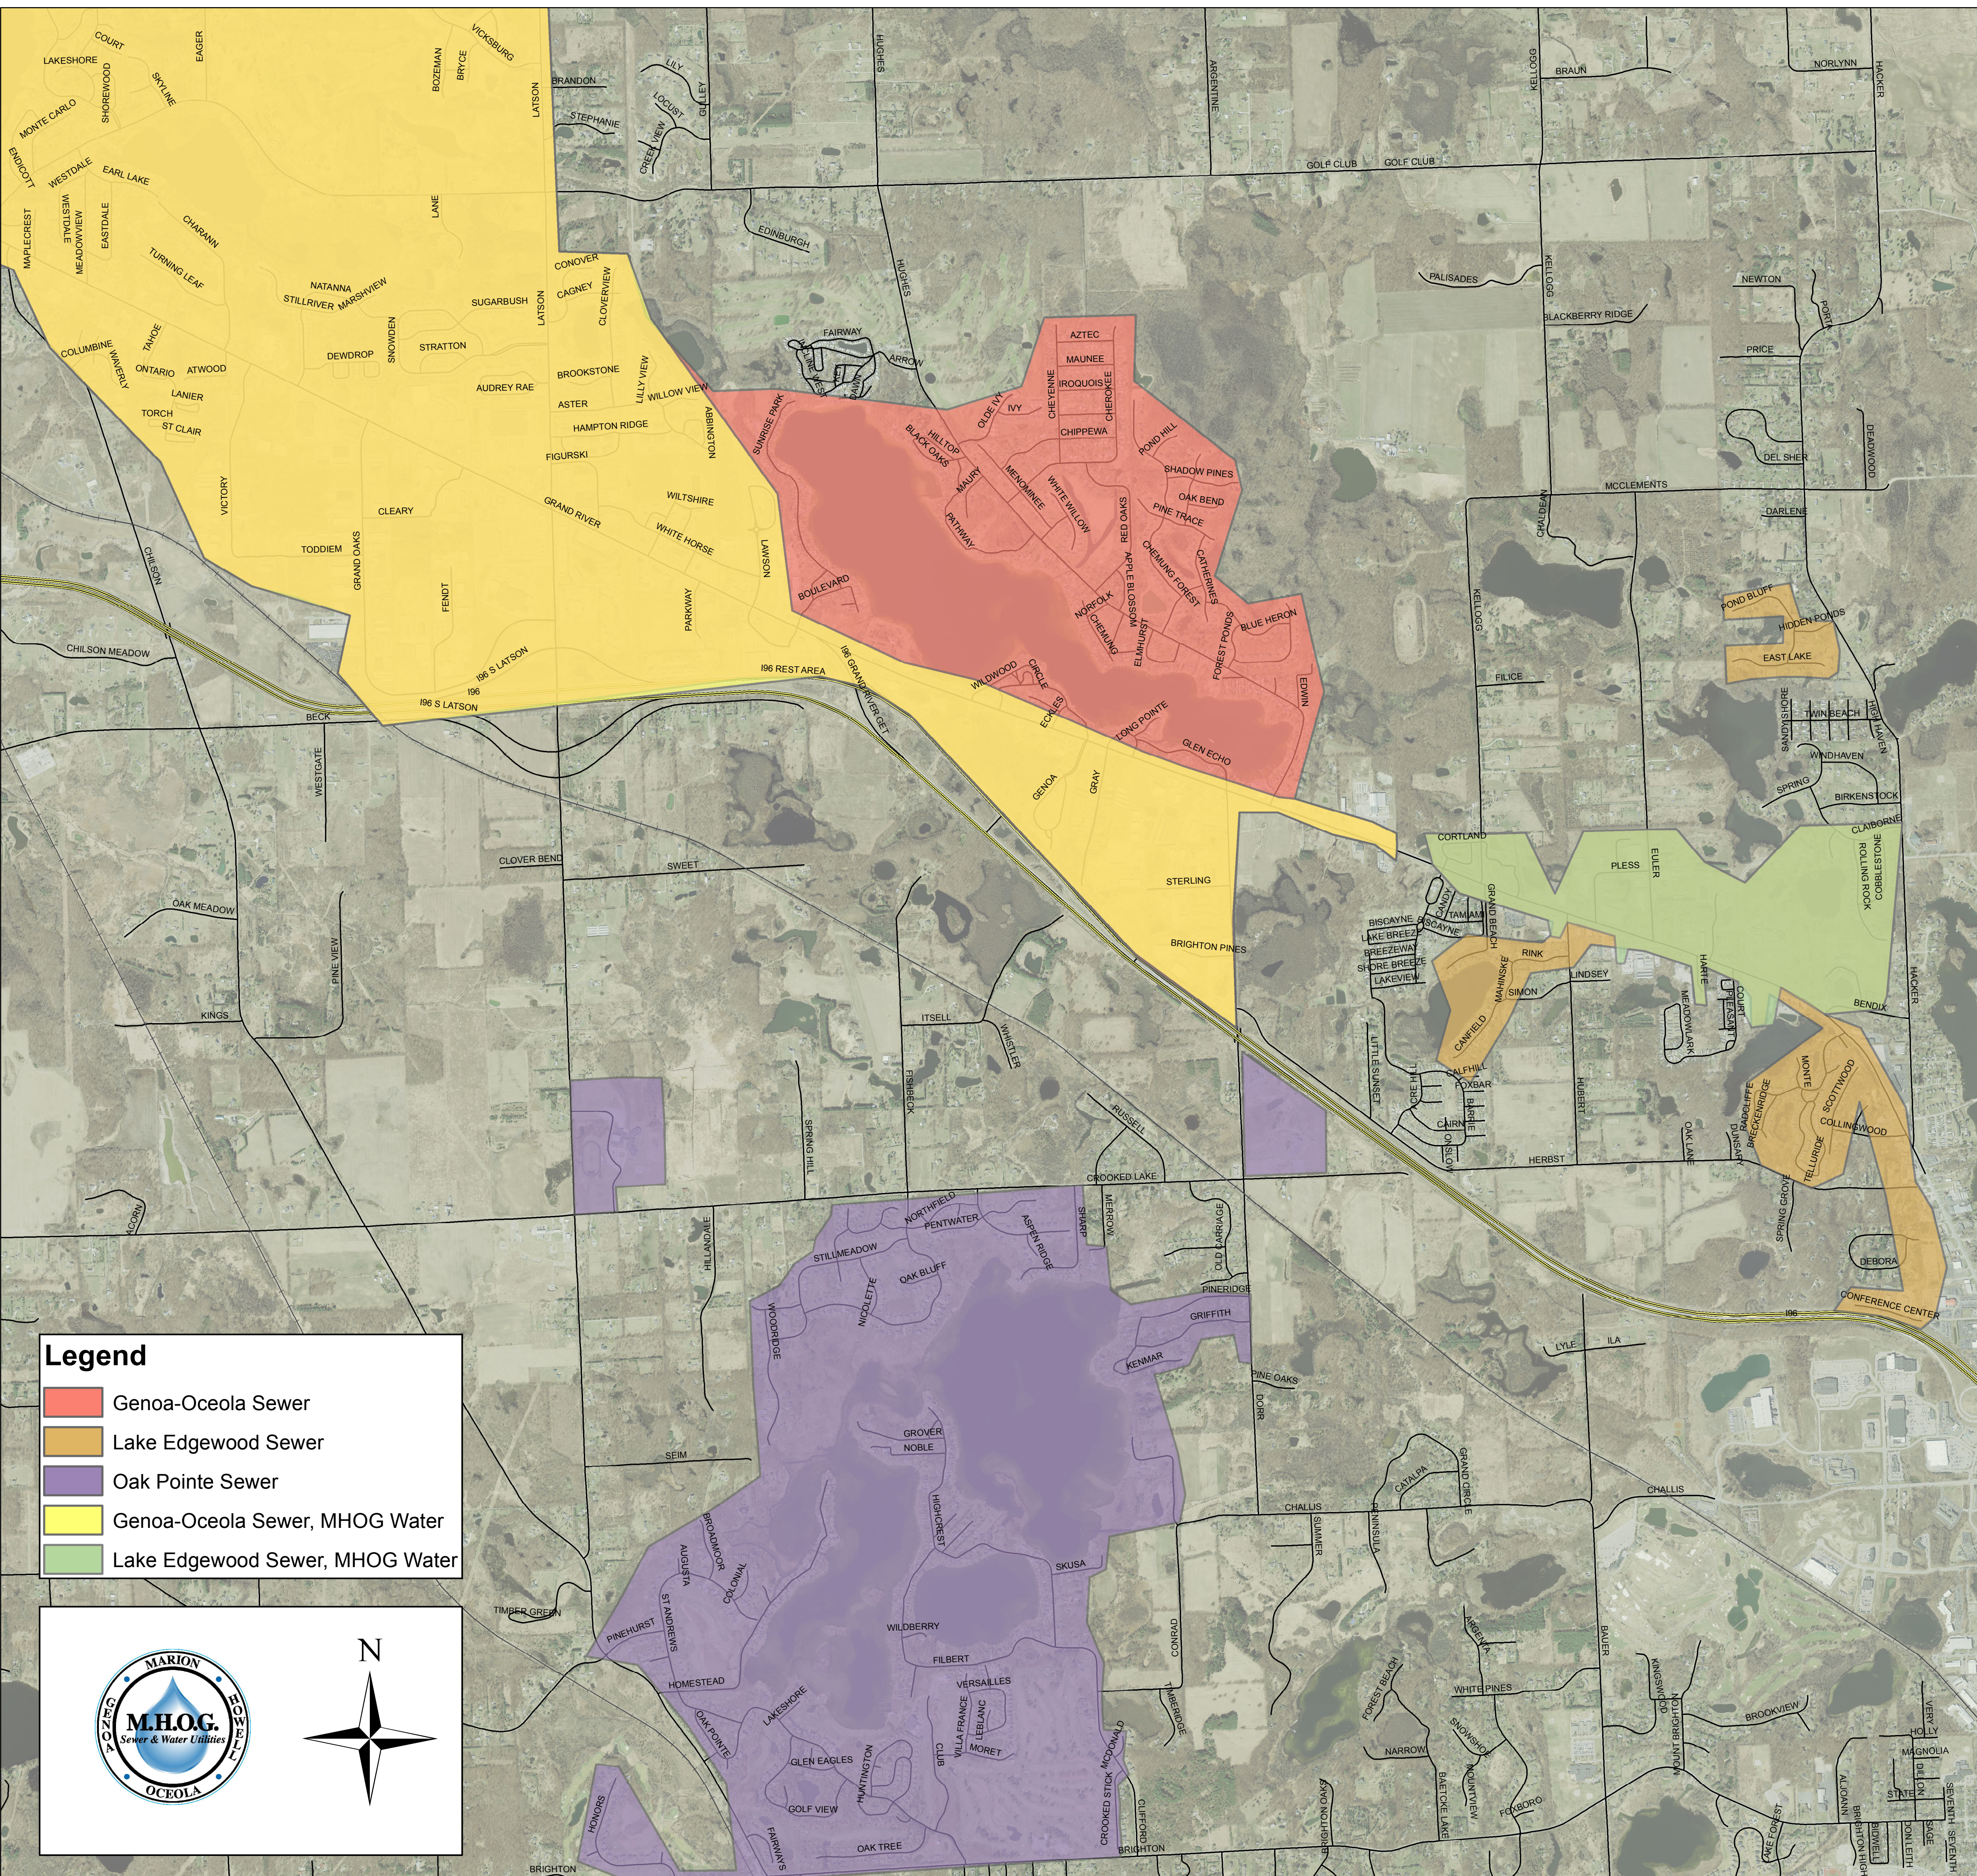

Legend

- Genoa-Oceola Sewer
- Lake Edgewood Sewer
- Oak Pointe Sewer
- Genoa-Oceola Sewer, MHOG Water
- Lake Edgewood Sewer, MHOG Water

Note: Boundaries are approximate, please see Township Staff for parcel specific information

